





RayClic-E

RayClic End Seal Kit Installation Instructions

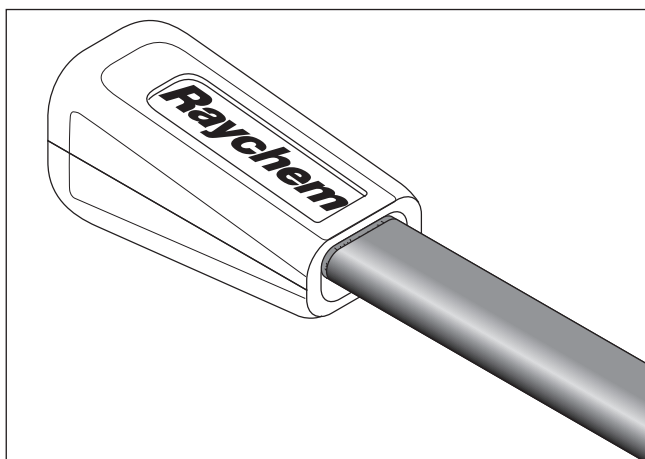

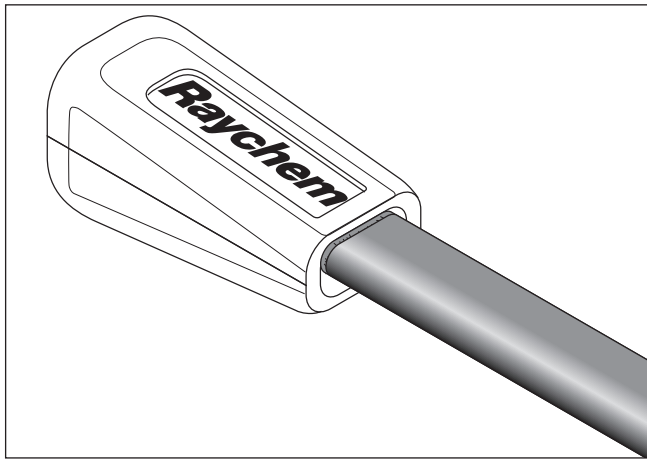

APPROVALS



Pipe Heating System 718K, ALSO LISTED De-icing and Snow Melting Equipment 877Z, AND De-icing and Snow Melting Equipment FOR USE IN HAZARDOUS LOCATION E538285
Hazardous Location Class I Div. 2 Group A, B, C, D T6 when installed with GM-1XT and GM-2XT only
-40°C ≤ Tambient ≤ +40°C

TOOLS REQUIRED

- Utility knife
- Diagonal cutters


DESCRIPTION

The Raychem RayClic-E end seal is for use with Raychem IceStop, XL-Trace Edge, HWAT and RaySol heating cables. Materials for one end seal termination are included in this kit. The appropriate Raychem power connection kit must also be used. These installation instructions should be used in conjunction with the IceStop, XL-Trace Edge, HWAT and RaySol System Installation and Operation Manuals. For technical support contact your Chemelex representative or call Chemelex (800) 545.6258.

Note: The end seal can be installed only once; it cannot be removed from the heating cable. Do not use until ready for final installation.

KIT CONTENTS

Qty	Description
1	Gel-filled end seal

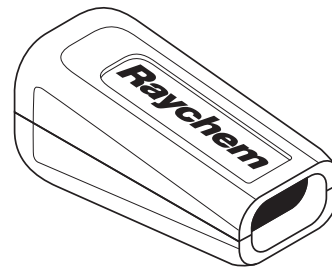

⚠ WARNING:

This component is an electrical device that must be installed correctly to ensure proper operation and to prevent shock or fire. Read these important warnings and carefully follow all the installation instructions.

- To minimize the danger of fire from sustained electrical arcing if the heating cable is damaged or improperly installed, and to comply with the requirements
- of Chemelex, agency certifications, and national electrical codes, ground fault equipment protection must be used. Arcing may not be stopped by conventional circuit breakers.
- Bus wires will short if they contact each other. Keep bus wires separated.
- The black heating cable core is conductive and can short. It must be properly

insulated and kept dry.



- Component approvals and performance are based on the use of Chemelex-specified parts only. Do not use substitute parts or vinyl electrical tape.
- Use only fire-resistant insulation materials such as fiberglass wrap.
- Leave these instructions with end user for reference and future use.

⚠ AVERTISSEMENT :

Le câble chauffant électrique doit être installé correctement pour éviter les risques d'incendie ou de décharge électrique. Lisez attentivement les mises en garde suivantes et suivez les instructions d'installation.



- Pour réduire le danger d'incendie causé par un arc électrique continu, si le câble chauffant est endommagé ou mal installé, et pour être conforme avec Chemelex, les organismes de certification et les codes applicables, il est impératif d'utiliser une protection par disjoncteur différentiel. Un disjoncteur ordinaire peut ne pas être assez sensible pour prévenir les arcs continus.
- Les fils omnibus peuvent être court-circuités s'ils se touchent. Tenez les fils omnibus éloignés les uns des autres
- Le noyau du câble chauffant noir est conducteur et peut occasionner des courts-circuits. Il doit être correctement isolé et gardé à sec.

- Les homologations et les performances des composants sont basées sur l'utilisation de pièces spécifiées par Chemelex seulement. N'utilisez pas de pièces de rechange ou de ruban isolant en vinyle.
- N'utiliser que des matériaux isolants ininflammables, par exemple une gaine de fibre de verre ou de la mousse ignifuge.
- Laisser ces instructions d'installation à l'utilisateur pour référence ultérieure.

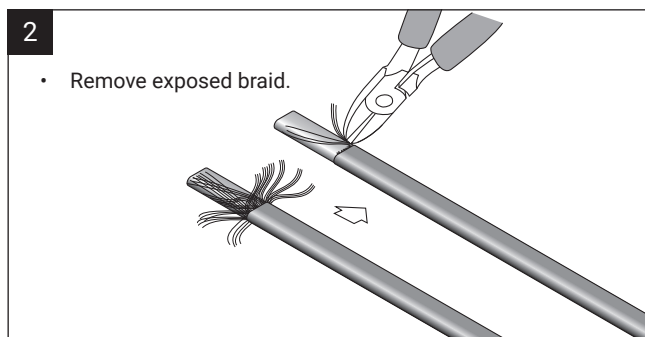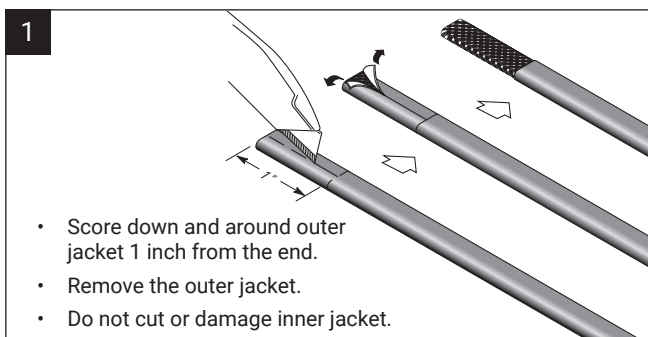

HWAT

IceStop, XL-Trace Edge, and RaySol

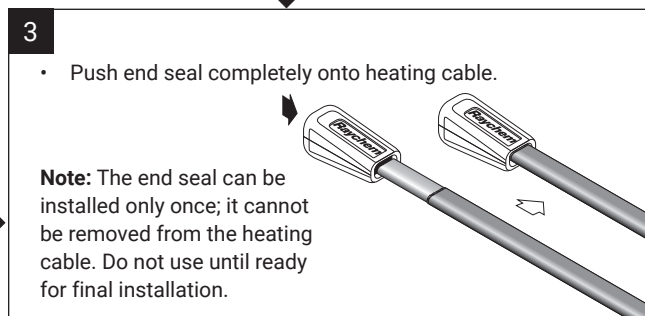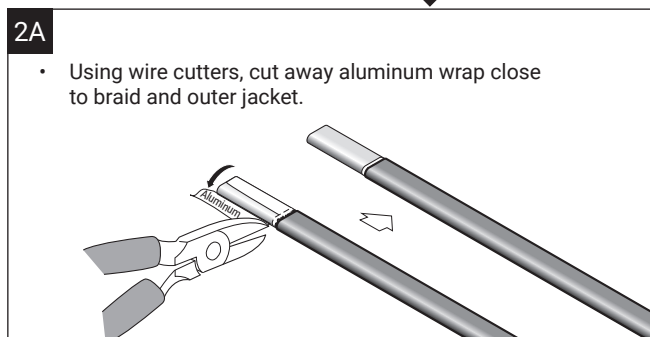

North America

Tel +1 800 545 6258
info@chemelex.com

Latin America

Tel +1 713 868 4800
info@chemelex.com

Europe, Middle East, Africa, India

Tel +32 16 213 511
Fax +32 16 213 604
info@chemelex.com

Asia Pacific

Tel +86 21 2412 1688
infoAPAC@chemelex.com

chemelex
excellence is everything

Raychem

Tracer

Pyrotenax

Nuheat